


**LEVELING PAD NOTES:**

1. THE LEVELING PAD SHALL BE CONSTRUCTED OF 6" MINIMUM COMPACTED OF GRADED CRUSHED STONE OR GRADED AGGREGATE BASE (GAB).
2. ANY FOUNDATION SOILS FOUND TO BE UNSUITABLE SHALL BE REMOVED AND REPLACED AS DIRECTED BY THE GEOTECHNICAL ENGINEER
3. THE BASE FOUNDATION SHALL BE APPROVED BY THE SITE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF THE LEVELING PAD

D = 3'-10 3/16" WITH THE 4-FT CONNECTOR

D = 2'-3 3/16" WITH THE 2-FT CONNECTOR

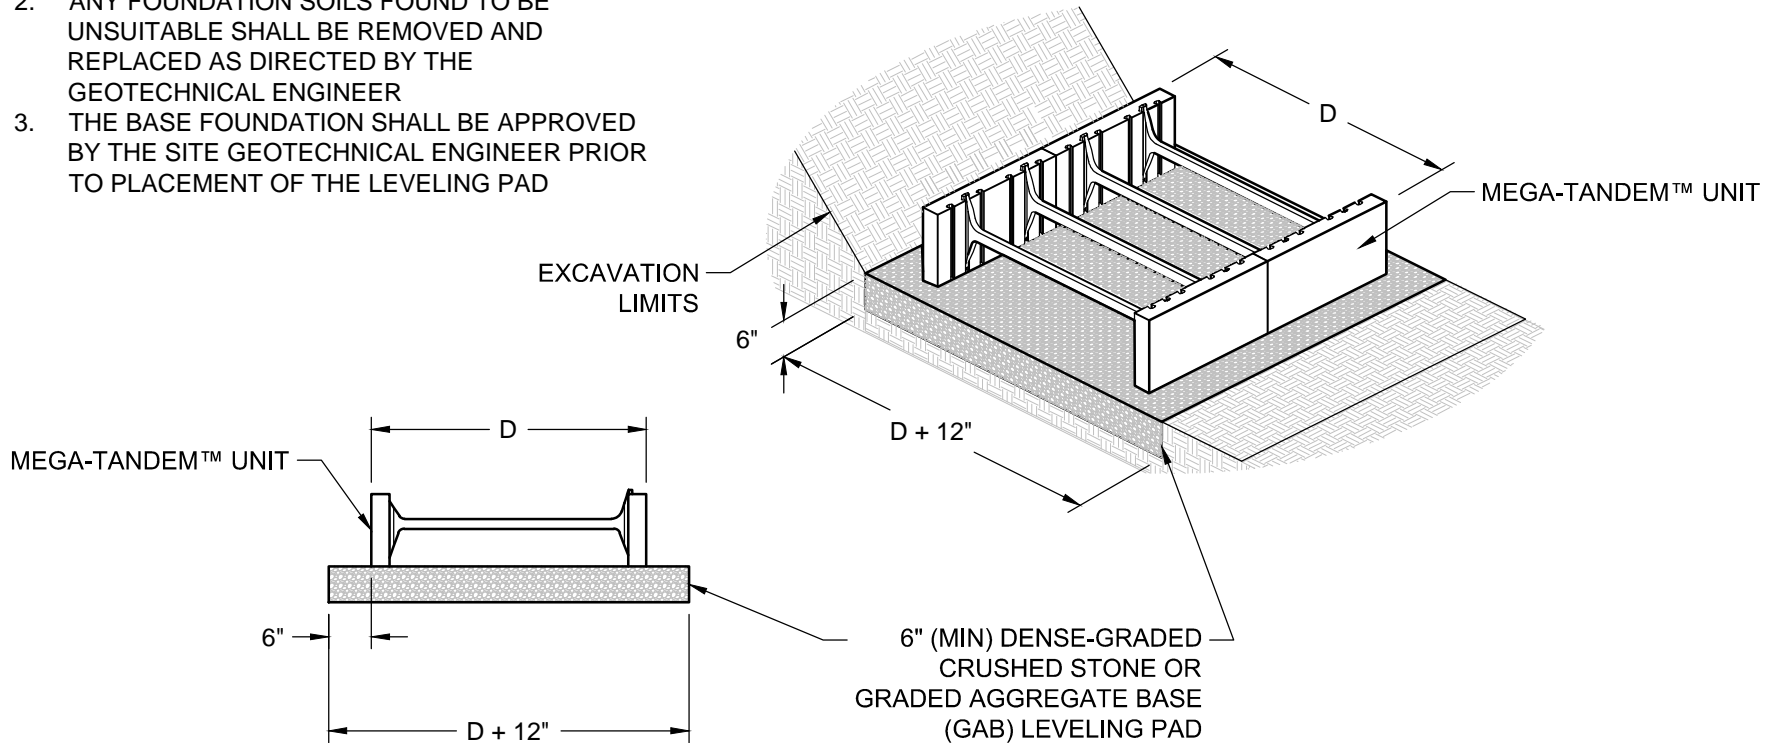

belgard.com  
877-235-4273  
details@belgard.com

This drawing is for illustrative purposes only and should not be used for construction without the signature of a registered professional engineer.

**MEGA-TANDEM™**  
**TYPICAL BASE LEVELING PAD DETAILS**

Scale:	None	Drawn by:	LM
Date:	2/24/2016	Drawing number:	MT04